


## JFD Standard Evolution 12 Single Engine Forward Lay to FDC

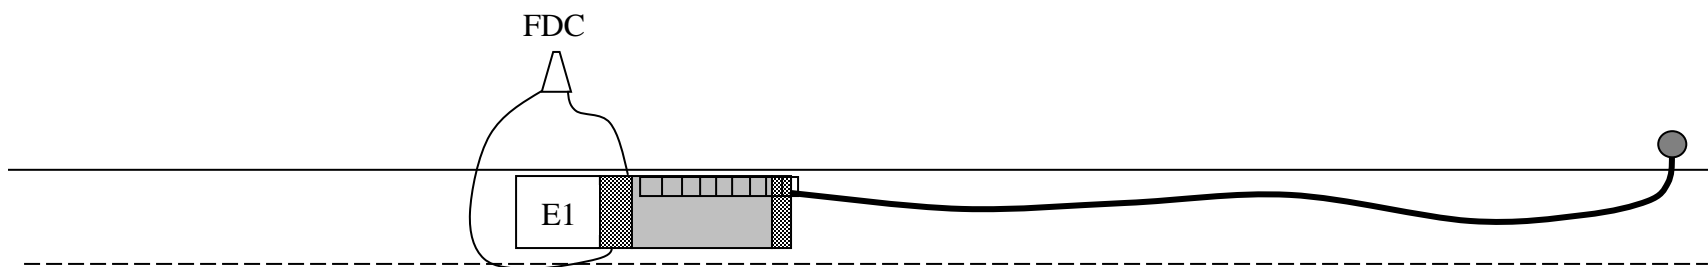

E1 lays a 5" LDH from the hydrant to the FDC

E1 establishes a water supply to the FDC

- Non-flowing Sprinkler system supply at 100 psi
- Flowing sprinkler system 150 psi
- Standpipe is (desired nozzle pressure + elevation + appliance)

Operate the line(s) at proper pressure and flow

Target Times

2-person crew 5 minutes