


JFD Standard Evolution #2 Reverse Lay and Supply the Attack Engine

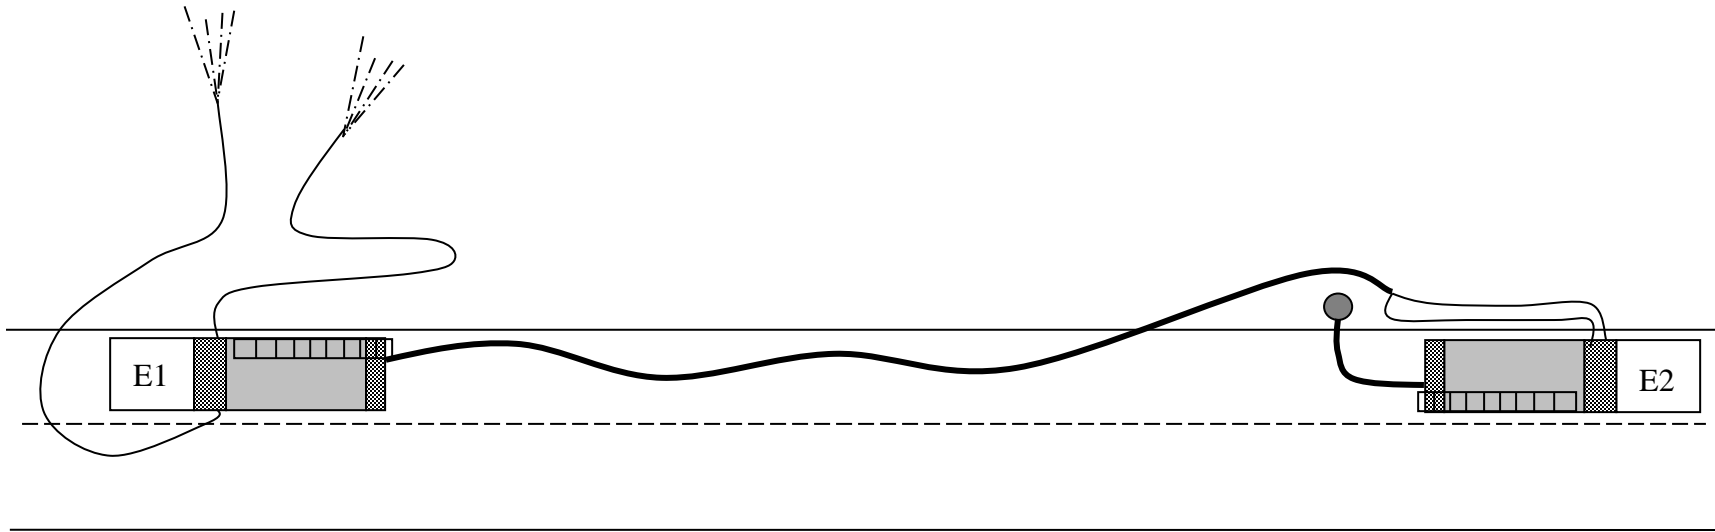

E1 Crew in SCBA's, advance one (1) 1 3/4" for attack line and (1) 1 3/4" for backup.
 E1 AO pump from tank switch to pressurized source
 E2 Crew in SCBA's, remove needed equipment from E2, man backup line, reverse lay 5" LDH line to the hydrant,
 E2 connect to the hydrant and supply E1
 Operate the line(s) at proper pressure and flows
 Only the AO stays with E2

Target Times
 E1 & E2 2-person crews, E1 deploys attack line and backup line, flow attack line with E1 crew, backup line with E2 crew, 9 minutes
 For each additional crew member on either engine reduce the time by 1 minute
 Target time for 8 total crew members is 5 minutes